

## Data sheet

### MULTICAL® 303 and MULTICAL® 403

- Fully programmable data logger with minute logger
- Configurable M-Bus communication with logger reading
- On-site configuration via front keys
- PN16/PN25 metal flow sensor – approved for up to 130 °C
- Battery lifetime of up to 16 years
- IP68 flow sensor
- 7- or 8-digit display resolution



MID 2014/32/EU




EN 1434

DK-BEK 1178 – 06.11.2014



EN 1434





## Contents

---

Description	3
Mechanical design MULTICAL® 303	4
Mechanical design MULTICAL® 403	5
Mechanical data	6
Approved meter data	7
Accuracy	8
Pressure loss	9
Dimensioned sketches MULTICAL® 303	10
Dimensioned sketches MULTICAL® 403	12
Electrical data	14
Product variants MULTICAL® 303	17
Meter configuration MULTICAL® 303	18
Product variants MULTICAL® 403	19
Meter configuration MULTICAL® 403	21
Information codes in display	22
Accessories	23



## Description

---

**MULTICAL® 303** is the compact all-round heat and cooling meter that can be installed everywhere due to its minimum dimensions. The meter can be turned during installation, even in the most compact systems, enabling you to always obtain optimal reading of the display.

The robust metal flow sensor tolerates continuous temperatures of up to 130 °C, is effectively protected against condensation and can be used in both PN16 and PN25 installations.

The flow sensor is constructed with Kamstrup's unique ultrasonic technique that ensures an extremely long lifetime – also in magnetite-containing heating systems.

MULTICAL® 303 consists of a flow sensor based on ultrasound, an electronic display unit and a Pt500 sensor set. These components are separately calibrated and then assembled to one heat, cooling or combined heat/cooling meter. If the components are separated, a reverification of the meter is required.

The meter has a built-in, programmable data logger that stores all relevant registers. Standard data logger registers are stored for 20 years, 36 months, 460 days and 72 hours.

During installation, the meter can be configured for installation of the flow sensor in either inlet or outlet pipe. Furthermore, the energy unit and resolution as well as date/time and M-Bus address can be adjusted merely by pressing a button – no special tools needed.

**MULTICAL® 403** is a static heat meter, cooling meter or combined heat/cooling meter based on the ultrasonic principle. The meter is intended for energy measurement in almost all types of thermal installations where water is used as the energy-conveying medium.

MULTICAL® 403 consists of a calculator, a flow sensor and two temperature sensors. MULTICAL® 403 has been developed for measurement of energy consumption in flats, single-family and multi-family houses, housing associations, blocks of flats and small industry. The meter is simple to install, and it has a temperature range of 2 ...180 °C and a meter programme with nominal flow from  $q_p$  0.6 m<sup>3</sup>/h to 15 m<sup>3</sup>/h.


The meter can be powered by mains or battery supply as required. You can choose between a small battery without transport restrictions or a more powerful battery with 16 years' lifetime. No matter which solution you choose, the power consumption of MULTICAL® 403 is low.

A wide range of parameters are configurable via the front keys of MULTICAL® 403: Flow sensor position in inlet or outlet, energy unit, primary M-Bus address, radio on/off, target dates, etc. Configuration can be carried out on site, thus contributing to a reduction of stocks and installation time.



## Mechanical design of MULTICAL® 303


---

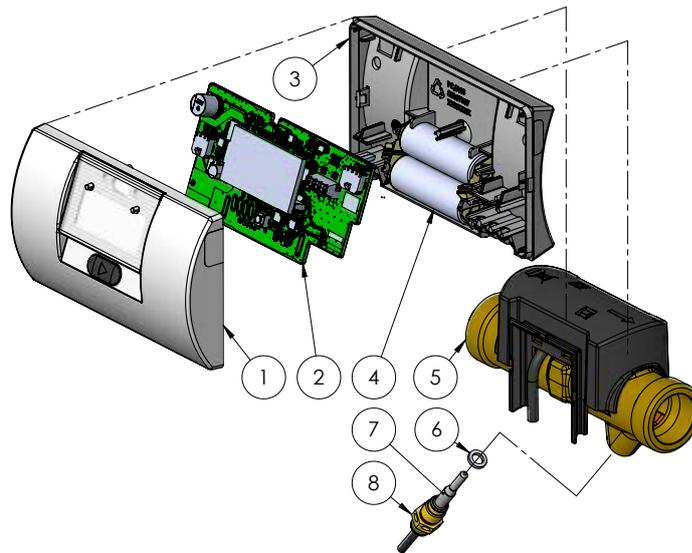

- 1 Top cover with front key and laser engraving
- 2 PCB with microcontroller, flow-ASIC, display, etc.
- 3 Base cover (may only be opened by an authorised laboratory)
- 4 One or two A-cell batteries
- 5 Flow sensor cover (may only be opened by an authorised laboratory)
- 6 O-ring, temperature sensor
- 7 Union, temperature sensor
- 8 Temperature sensor ( $\varnothing 5.0 - \varnothing 5.2 - DS 27.5$ )



## Mechanical design of MULTICAL® 403

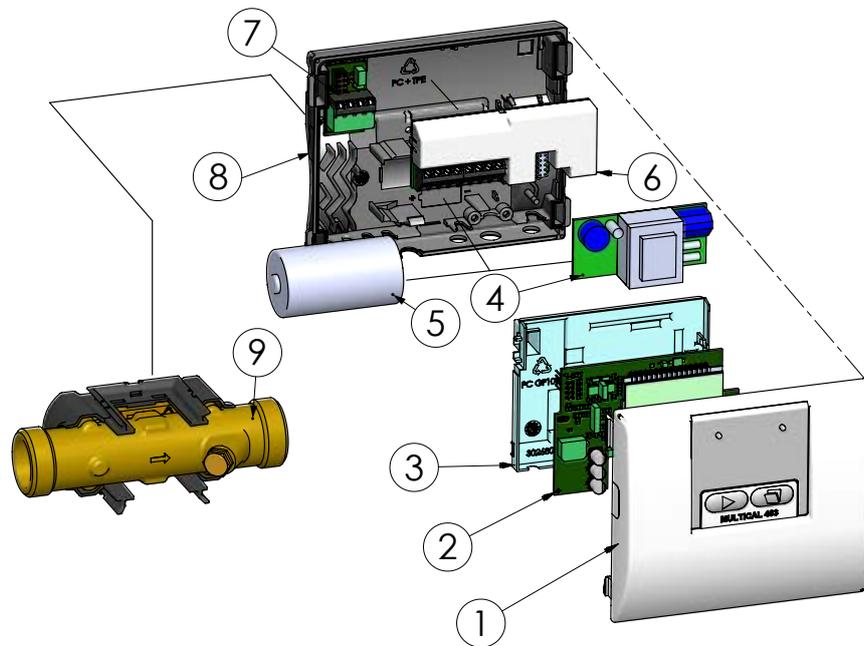

- 1 Top cover with front keys and laser engraving
- 2 PCB with microcontroller, flow-ASIC, display, etc.
- 3 PCB cover (may only be opened by an authorised laboratory)
- 4 Either a power supply module can be mounted
- 5 Or a battery can be mounted
- 6 Data module, e.g. M-Bus
- 7 Connection of temperature sensors
- 8 Bottom cover
- 9 Flow sensor (IP68)



## Mechanical data

	MULTICAL® 303	MULTICAL® 403
<b>Weight (depending on the flow sensor size)</b>	0.7 kg – 0.8 kg	0.9 – 8.6 kg
<b>Ambient temperature</b>	5...55 °C. Non-condensing, closed location (indoor installation)	
<b>Protection class</b>		
Calculator	IP65	IP54
Flow sensor	IP68	IP68
<b>Media temperatures</b>	At media temperatures below the ambient temperature or above 90 °C, wall-mounting of the calculator is recommended.	
Heat meters	303-W: 2...130 °C	403-W: 2...130 °C
Cooling meters	303-C: 2...50 °C	403-C: 2...50 °C
Heat/cooling meters	303-T: 2...130 °C	403-T: 2...130 °C
<b>Medium in flow sensor</b>	Water (district heating water as described in CEN TR 16911 and AGFW FW510)	
<b>Storage temperature</b>	-25...60 °C (drained flow sensor)	
<b>Pressure stage</b>	PN16/PN25, PS25	
<b>Flow sensor cable</b>	1.5 m (the cable is non-detachable)	
<b>Temperature sensor cables</b>	1.5 m or 3 m	1.5 m, 3 m or 10 m
<b>Connection cables</b>		ø3.5...6 mm
<b>Supply cables</b>		ø5...8 mm

## Materials

	MULTICAL® 303	MULTICAL® 403
<b>Wetted parts</b>		
Case, coupling	Hot forged, dezincification-resistant brass (CW 602N)	
Case, flange		Stainless steel, W.nr. 1.4308
Transducer	Stainless steel, W.nr. 1.4404	
O-rings	EPDM	
Measuring tube	Thermoplastic, PES 30 % GF	
Reflektors	Thermoplastic, PES 30 % GF and stainless steel, W.nr. 1.4306	
<b>Flow sensor casing</b>		
Flow sensor cover	Thermoplastic, PC 20 % GF	
Wall bracket	Thermoplastic, PC 20 % GF	
<b>Calculator casing</b>		
Top	Thermoplastic, PC 10 % GF with TPE (thermoplastic elastomer)	
Base	Thermoplastic, PC/ABS	
Internal cover		Thermoplastic, PC 10 % GF
<b>Cables</b>	Silicone cable with inner Teflon insulation	




## Approved meter data

	MULTICAL® 303	MULTICAL® 403
<b>Approvals</b>		
Heat meter	DK-0200-MI004-045	DK-0200-MI004-037
– Temperature range	θ: 2 °C...180 °C	
– Differential range	Δθ: 3 K...178 K	
Cooling meter	TS 27.02 015	TS 27.02 009
– Temperature range	θ: 2 °C...180 °C	
– Differential range	Δθ: 3 K...178 K	
Bifunctional heat/cooling meter	DK-0200-MI004-045 and TS 27.02 015	DK-0200-MI004-037 and TS 27.02 009
– Temperature range	θ: 2 °C...180 °C	
– Differential range	Δθ: 3 K...178 K	
	The stated minimum temperatures only relate to the type approval. The meter has no cut-off for low temperature and thus measures down to 0.01 °C and 0.01 K.	
<b>Standards and norms</b>	EN 1434:2007/AC:2007 EN 1434:2015+A1:2018 EN 1434:2022 BEK1178	
<b>EU directives</b>	Measuring Instruments Directive Low Voltage Directive Electromagnetic Compatibility Directive Radio Equipment Directive RoHS Directive Pressurised equipment Directive	
<b>EN 1434 designation</b>	Environmental class A	Environmental class A and C
<b>MID designation</b>		
Mechanical environment	Class M1 and M2	
Electromagnetic environment	Class E1	Class E1 and E2
	5...55 °C. Non-condensing, closed location (indoor installation)	
<b>Temperature sensor</b>	Pt500 – EN 60751	

**Accuracy**

Meter components	MPE according to EN 1434-1	MULTICAL® 303 and MULTICAL® 403, typical accuracy
Calculator	$E_c = \pm [0.5 + \Delta\Theta \text{ min}/\Delta\Theta] \%$	$E_c = \pm [0.15 + 2/\Delta\Theta] \%$
Flow sensor	$E_f = \pm [2 + 0.02 q_p/q]$ , but not over $\pm 5 \%$	$E_f = \pm [1 + 0.01 q_p/q] \%$
Sensor set	$E_t = \pm [0.5 + 3 \Delta\Theta \text{ min}/\Delta\Theta] \%$	$E_t = \pm [0.4 + 4/\Delta\Theta] \%$

Total typical accuracy of MULTICAL® 303 and MULTICAL® 403 compared to EN 1434-1.

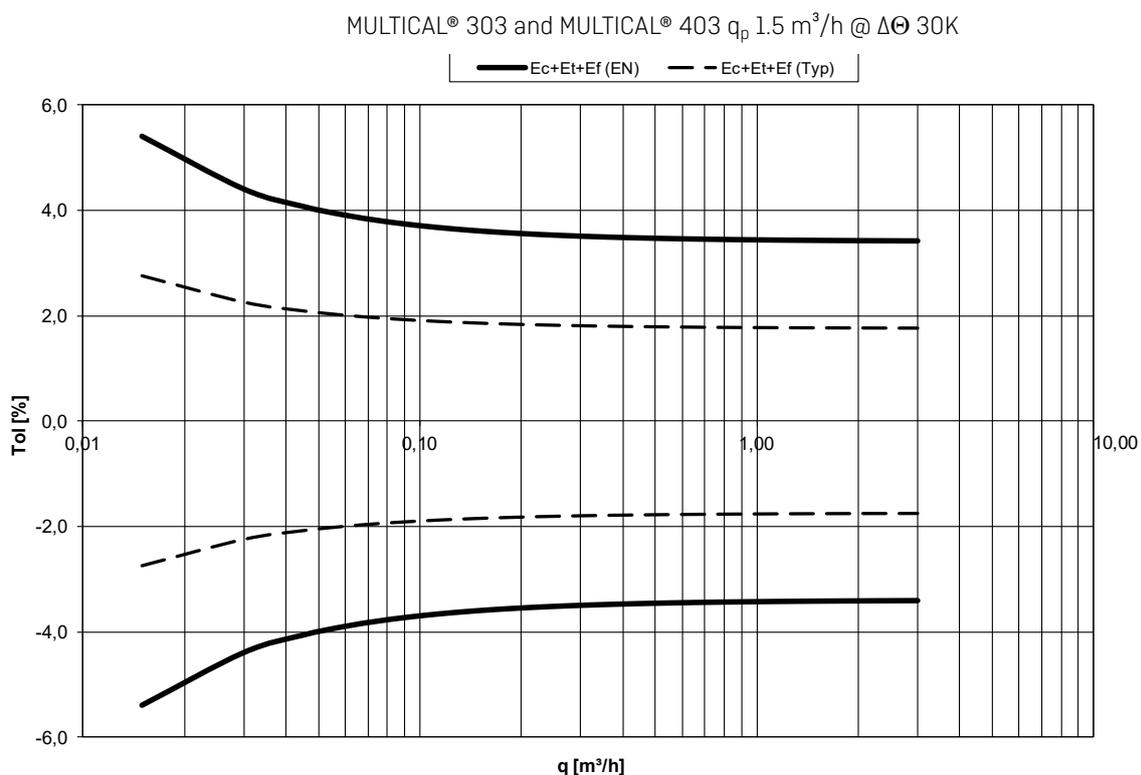



## Pressure loss


The pressure loss in a flow sensor is stated as the maximum pressure loss at  $q_p$ .

According to EN 1434, the maximum pressure loss must not exceed 0.25 bar.

Graph	Nom. flow $q_p$ [m <sup>3</sup> /h]	Max flow $q_s$ [m <sup>3</sup> /h]	Min. flow $q_i$ * [l/h]	Min. flow cut-off [l/h]	Saturation flow [m <sup>3</sup> /h]	Nom. diameter [mm]	$\Delta p@q_p$ [bar]	$k_v$	$q@0.25 \text{ bar}$ [m <sup>3</sup> /h]	MULTICAL® 303	MULTICAL® 403
A	0.6	1.2	6	3	1.5	DN15/DN20	0.03	3.46	1.7	x	x
B	1.5	3.0	15	3	4.6	DN15/DN20	0.09	4.89	2.4	x	x
C	2.5	5.0	25	5	7.6	DN20	0.09	8.15	4.1	x	x
D	3.5	7.0	35	7	9.2	DN25	0.07	13.42	6.8		x
E	6	12	60	12	18	DN25	0.06	24.5	12.3		x
F	10	20	100	20	30	DN40	0.06	40.83	20.4		x
F	15	30	150	30	46	DN50	0.14	40.09	20.1		x

\* Dynamic area  $q_p:q_i = 100:1$


$\Delta p$  MULTICAL® 303 and MULTICAL® 403

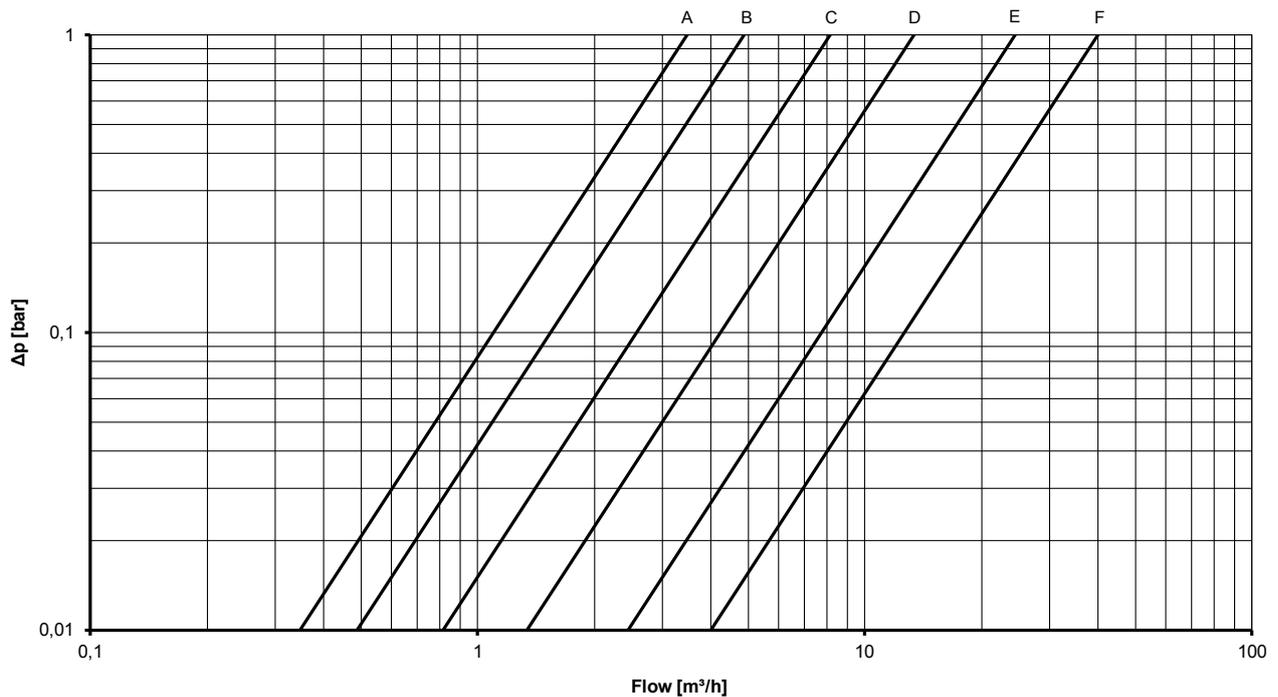


 **Dimensioned sketches of MULTICAL® 303**

All measurements in [mm]


**Calculator**

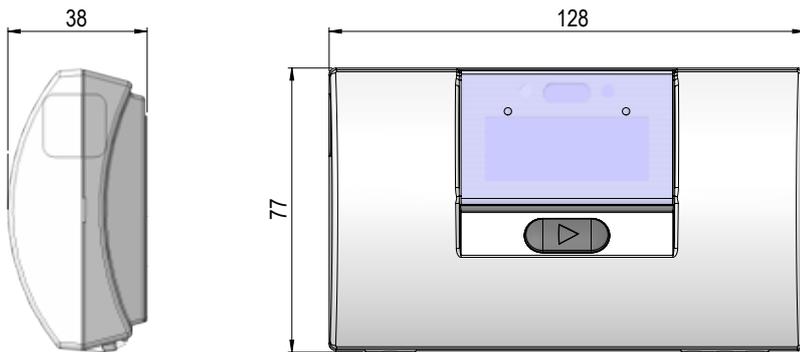


**Complete MULTICAL® 303 with calculator mounted on flow sensor**

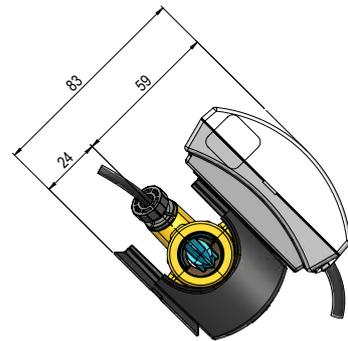

**Calculator mounted with wall bracket**

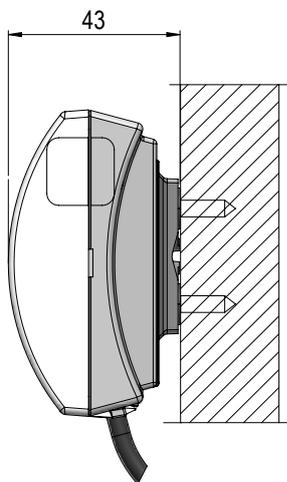


**Wall bracket for calculator**

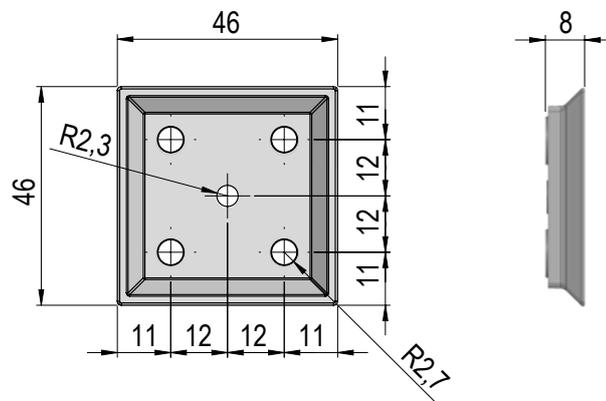


 Dimensioned sketches of MULTICAL® 303


**Direct short temperature sensor**

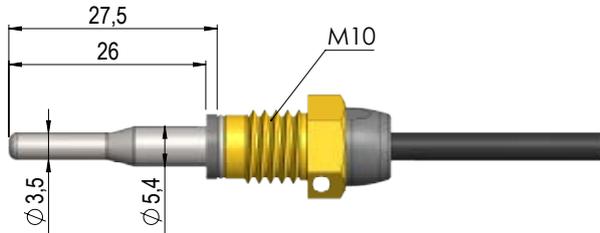

**Pocket temperature sensor with composite union**

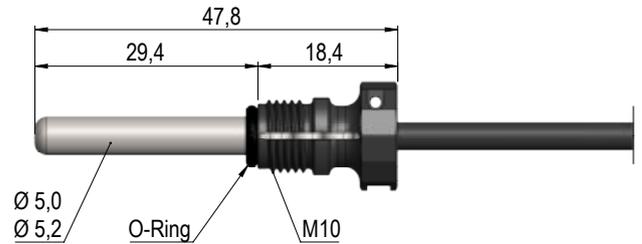

**Flow sensor**

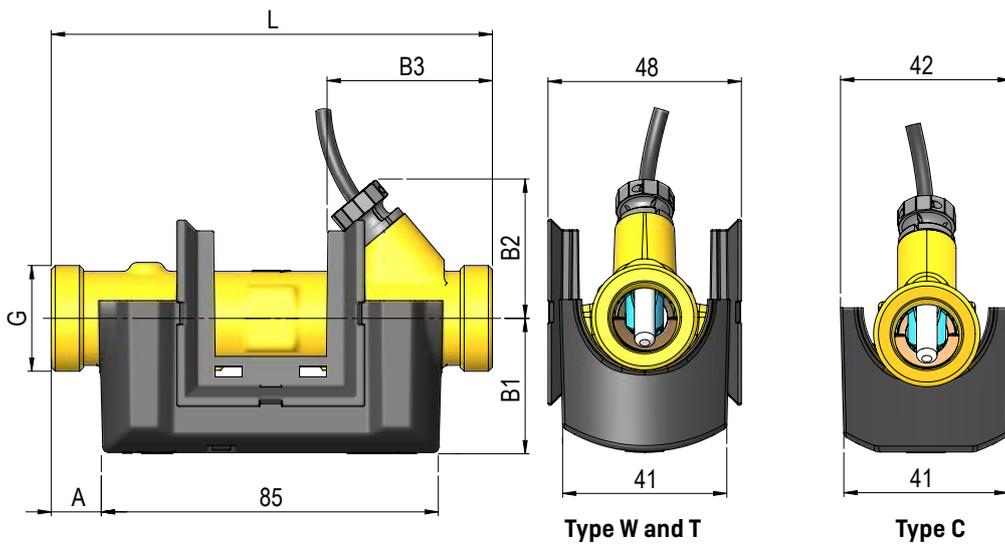


Thread	L [mm]	A [mm]	B1 [mm]	B2 [mm]	B3 [mm]	Approx. weight [kg] *
G $\frac{3}{4}$ B (R $\frac{1}{2}$ )	110	12	35	35	40	0.7
G1B (R $\frac{3}{4}$ )	130	22	38	38	50	0.8

\* The weight indication includes the complete meter including flow sensor, calculator, sensor set and 2 x A-batteries. Any provided accessories such as couplings, nipples and sensor pockets as well as packaging are not included in the weight indication.


 **Dimensioned sketches of MULTICAL® 403**

All measurements in [mm]


**Calculator**

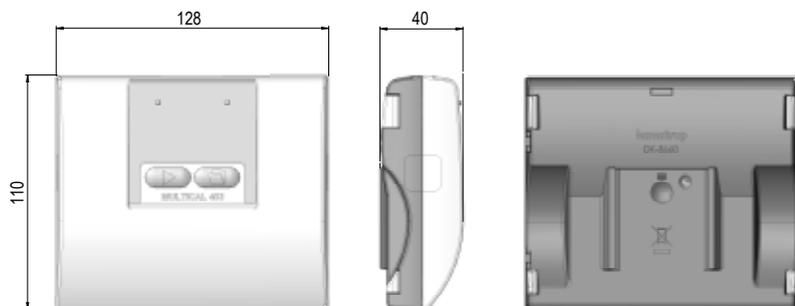

**Wall bracket for calculator**

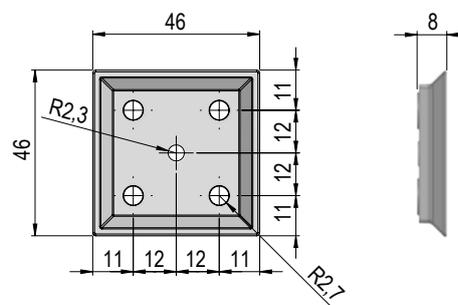

**Flow sensor with G¾ and G1 thread connection**

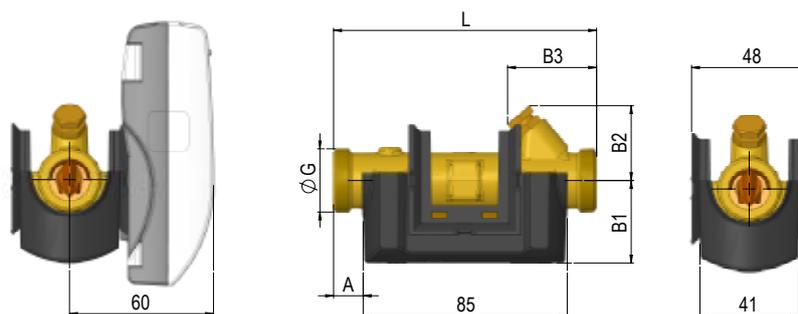

Nominal flow $q_p$ [m³/h]	Thread G	L	A	B1	B2	B3	Approx. weight [kg] *
0.6 + 1.5	G¾B	110	12	35	32	38	0.9
1.5	G¾B	165	12	35	32	65	1.0
1.5	G1B	130	22	38	32	48	1.0
2.5	G1B	130	22	38	38	48	1.0
0.6 + 1.5	G1B	190	22	38	38	78	1.1
2.5	G1B	190	22	38	38	78	1.2


\* Weight of calculator, flow sensor, 3 m sensor pair excl. packaging



## Dimensioned sketches of MULTICAL® 403

All measurements in [mm]


### Flow sensor with G5/4 and G2 threaded connection

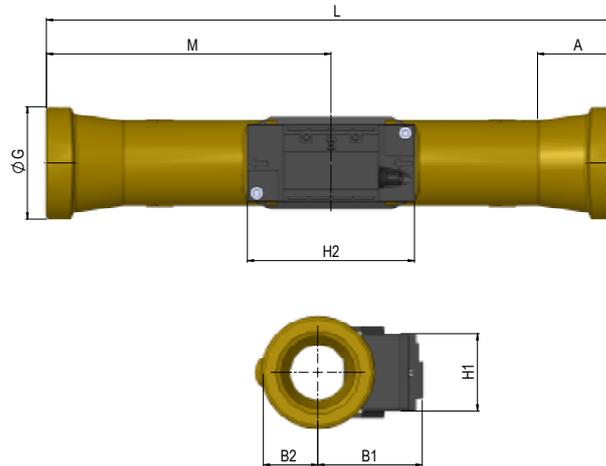

Nominal flow $q_p$ [m <sup>3</sup> /h]	Thread G	L	M	H2	A	B1	B2	H1	Approx. weight [kg] *
3.5	G5/4B	260	130	88	16	51	20	41	2.0
6	G5/4B	260	130	88	16	53	20	41	2.1
10	G2B	300	150	88	40.2	55	29	41	3.0

\* Weight of calculator, flow sensor, 3 m sensor pair excl. packaging

### Flow sensor with DN25, DN40 and DN50 flange connection

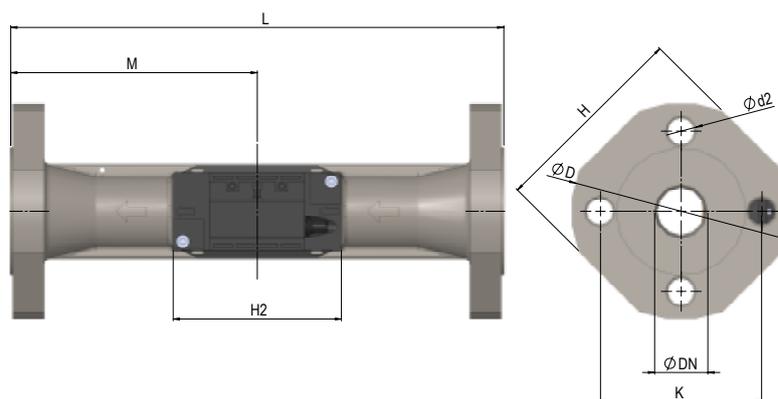

Nominal flow $q_p$ [m <sup>3</sup> /h]	Nom. diameter DN	L	M	H2	D	H	K	Bolts			Approx. weight [kg] *
								Qty	Thread	d2	
6	DN25	260	130	88	115	106	85	4	M12	14	4.6
10	DN40	300	150	88	150	140	110	4	M16	18	7.5
15	DN50	270	155	88	165	145	125	4	M16	18	8.6

\* Weight of calculator, flow sensor, 3 m sensor pair excl. packaging



## Electrical data

	MULTICAL® 303		MULTICAL® 403	
<b>Calculator data</b>				
Display	LCD – 7 or 8 digits with a digit height of 6.8 mm		LCD – 7 or 8 digits with a digit height of 8.2 mm	
Resolutions	9999,999 – 99999,99 – 999999,9 – 9999999 99999,999 – 999999,99 – 9999999,9 – 99999999			
Energy units	MWh – kWh – GJ			
<b>Data logger (EEPROM)</b>				
Logger contents	Programmable - all registers can be selected			
Logging interval	Programmable - from 1 minute to 1 year			
Logging depth	Programmable - standard: 20 years, 36 months, 460 days, 72 hours			
<b>Info logger (EEPROM)</b>	50 info codes (50 latest are shown in the display)			
<b>Clock/calendar (with backup battery)</b>	Clock, calendar, leap year compensation, target date			
<b>Daylight saving time/wintertime (DST)</b>	Programmable The function can be disabled so that "technical normal time" is used			
<b>Clock accuracy</b>	Without external adjustments: Less than 15 minutes/year With external adjustment every 48 hours: Less than 7 s from legal time			
<b>Data communication</b>	KMP protocol with CRC16 is used for optical communication –			
	and for modules in MULTICAL® 403			
<b>Power in temperature sensors</b>	< 10 $\mu$ W RMS			
<b>Supply voltage</b>	3.6 VDC $\pm$ 0.1 VDC			
<b>Battery</b>				
Type	3.65 VDC 1 x A-cell	3.65 VDC 2 x A-cell	3.65 VDC 1 x D-cell	3.65 VDC 2 x A-cell
Life The battery lifetime is affected by the meter's communication and setup parameters as well as transmission interval, transmission power and datagram contents.	Up to 8 years @ $t_{BAT}$ < 30 °C	Up to 16 years @ $t_{BAT}$ < 30 °C		Up to 9 years @ $t_{BAT}$ < 30 °C
Lithium contents	Approx. 0.9 g	2 x approx. 0.9 g	Approx. 4.9 g	2 x approx. 0.9 g



## Electrical data

<b>Battery</b>	<b>MULTICAL® 403</b>
Backup battery (for real-time clock)	3.0 VDC, BR-cell lithium
Battery lifetime expected for a meter fitted with an NB-IoT module	Up to 12 years (daily transmission) depending on the installation site and the NB-IoT coverage level called "CE level"
<b>Mains supply</b>	230 VAC +15/-30 %, 50/60 Hz 24 VAC ±50 %, 50/60 Hz 24 VDC +75/-25 % [24 VDC only for High Power SMPS]
Insulation voltage	3.75 kV
Power consumption	< 1 W
Backup supply	Integral SuperCap eliminates interruptions due to short-term power failures (only supply module types 7 and 8)



## Electrical data

Temperature measurement MULTICAL® 303 and MULTICAL® 403	t1 Inlet temperature	t2 Outlet temperature	$\Delta\theta$ (t1-t2) Heat measurement	$\Delta\theta$ (t2-t1) Cooling measurement	t5 Preset for A1 and A2 (only MULTICAL® 403)
Measuring range 2-wire, Pt500 [303-W/C/T] 2-wire, Pt500 [403-W/C/T]	0.01...185.00 °C				
Offset adjustment	± 0.99 K				

Max cable lengths	Pt500, 2-wire
Max $\varnothing$ 6 mm cable. Cable only replaceable on MULTICAL® 403	
	2 x 0.25 mm <sup>2</sup> : 10 m

### Electrical data for MULTICAL® 403

Pulse inputs In-A/In-B	Electronical contact	Reed contact
Pulse input	680 k $\Omega$ pull-up for 3.6 V	680 k $\Omega$ pull-up for 3.6 V
Pulse ON	< 0.4 V for > 30 ms	< 0.4 V for > 500 ms
Pulse OFF	> 2.5 V for > 30 ms	> 2.5 V for > 500 ms
Pulse frequency	< 3 Hz	< 1 Hz
Electrical isolation	No	No
Max cable length	25 m	25 m
Requirements for external contact	Leakage current at function open < 1 $\mu$ A	

Pulse outputs Out-C/Out-D	
Pulse output type	Opto FET
External voltage	1...48 VDC/VAC
Current	< 50 mA
Residual stress	$R_{ON} \leq 40 \Omega$
Electrical isolation	2 kV
Max cable length	25 m



## Product variants MULTICAL® 303

MULTICAL® 303 type number	Type 303	Static data Written on the front of the meter 303-x-xx-x-xx			Dynamic data Shown in the display xx-x-xx		
		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>Sensor connection</b>							
Pt500 Heat meter	W						
Pt500 Heat/cooling meter	T						
Pt500 Cooling meter	C						
<b>Flow sensor <sup>1)</sup></b>							
$q_p$ [m <sup>3</sup> /h]	Connection	Length [mm]	Dynamic range				
0.6	G $\frac{3}{4}$ B (R $\frac{1}{2}$ )	110	100:1	10			
1.5	G $\frac{3}{4}$ B (R $\frac{1}{2}$ )	110	100:1	40			
1.5	G1B (R $\frac{3}{4}$ )	130	100:1	70			
2.5	G1B (R $\frac{3}{4}$ )	130	100:1	A0			
<b>Meter type</b>							
Heat meter (MID module B+D)				2			
Heat/cooling meter (MID module B+D & TS27.02+DK268) <sup>2)</sup>	$\theta_{hc}$ = OFF			3			
Heat meter, National approvals				4			
Cooling meter (TS27.02+DK268)				5			
Heat/cooling meter (MID module B+D & TS27.02+DK268) <sup>2)</sup>	$\theta_{hc}$ = ON			6			
<b>Country code</b>							
Determined by Kamstrup upon receipt of order						XX	
<b>Temperature sensor set (Pt500)</b>							
	Length [mm]	Diameter $\varnothing$ [mm]	Cable length [m]				
Direct short temperature sensors	27.5	-	1.5	51			
Direct short temperature sensors	27.5	-	3.0	52			
$\varnothing$ 5.0 with composite unions	-	5.0	1.5	61			
$\varnothing$ 5.0 with composite unions	-	5.0	3.0	62			
$\varnothing$ 5.2 with composite unions	-	5.2	1.5	71			
$\varnothing$ 5.2 with composite unions	-	5.2	3.0	72			
<b>Supply <sup>3)</sup></b>							
Battery, 1 x A-cell	Battery lifetime of up to 8 years			1			
Battery, 2 x A-cells	Battery lifetime of up to 16 years			9			
<b>Communication</b>							
M-Bus, configurable							20
Wireless M-Bus, configurable 868.95 MHz EU							30

- The flow sensors are type-approved for the dynamic ranges  $q_p:q_i = 250:1$  and  $100:1$ , but are as standard delivered as  $100:1$ . Please contact Kamstrup A/S for further information.
- In some countries, bi-functional meters type 3 and 6 are only allowed to be assigned with the MID marking due to national law.
- The battery lifetime is affected by the meter's communication and setup parameters as well as transmission interval, transmission power and data-gram contents. Please contact Kamstrup A/S for calculations of specific configurations.



## Meter configuration MULTICAL® 303

	A	B	CCC	DDD	L	RR	T	VVVV	XXX	YY	ZZZ
<b>Flow sensor position</b>											
Inlet		3									
Outlet		4									
<b>Measuring unit</b>											
GJ		2									
kWh		3									
MWh		4									
<b>Flow sensor coding</b>											
Normal/high resolution [7 digits]			4xx								
High resolution [8 digits]			5xx								
<b>Display</b>											
Heat meter				210							
Heat/cooling meter				310							
Cooling meter				510							
<b>Integration mode</b>											
Adaptive mode [4-64 s]					5						
Normal mode [32 s]					6						
Fast mode [4 s]					7						
<b>Data logger profile</b>											
Standard data logger profile						30					
<b>Encryption level</b>											
Individual key							3				
<b>Customer label</b>											
Serial number									xxxx		
<b>Communication configuration</b>											
<b>Communication hardware</b>											
M-Bus [selection in type number]									x20		
Wireless M-Bus [selection in type number]									x30		
<b>System configuration (wM-Bus)</b>											
<a href="#">See the technical description - 5512-2701</a>										YY	
<b>Datagram (M-Bus/wM-Bus)</b>											
<a href="#">See the technical description - 5512-2701</a>											ZZZ

Please contact Kamstrup A/S for further information on configuration options.



## Product variants MULTICAL® 403

### MULTICAL® 403 type number

				Static data Written on the front of the meter 403-X XX X XX –				Dynamic data Shown in the display XX X XX				
				Type 403-	□	□□	□	□□	–	□□	□	□□
<b>Sensor connection</b>												
Pt500 heat meter				W								
Pt500 cooling meter				C								
Pt500 cooling meter and heat/cooling meter				T								
Flow sensor	Connection	Length	Dynamic									
$q_p$ [m <sup>3</sup> /h]		[mm]	range									
0.6	G¾B (R½)	110	100:1	10								
0.6	G1B (R¾)	190	100:1	30								
1.5	G¾B (R½)	110	100:1	40								
1.5	G¾B (R½)	165	100:1	50								
1.5	G1B (R¾)	110	100:1	60								
1.5	G1B (R¾)	130	100:1	70								
1.5	G1B (R¾)	165	100:1	[130 mm with extension] 80								
1.5	G1B (R¾)	190	100:1	90								
2.5	G1B (R¾)	130	100:1	A0								
2.5	G1B (R¾)	190	100:1	B0								
3.5	G5/4B (R1)	260	100:1	D0								
6.0	G5/4B (R1)	260	100:1	F0								
6.0	DN25	260	100:1	G0								
10	G2B (R1½)	300	100:1	H0								
10	DN40	300	100:1	J0								
15	DN50	270	100:1	K0								
<b>Meter type</b>												
Heat meter (MID module B)				1								
Heat meter (MID modules B+D)				2								
Heat/cooling meter (MID modules B+D & TS+DK268) *				3								
Heat meter (national approvals)				4								
Cooling meter (TS+DK268)				5								
Heat/cooling meter (MID modules B+D & TS+DK268) *				6								
Volume meter, hot				7								
Volume meter, cold				8								
<b>Country code</b>												
Determined by Kamstrup upon receipt of order				XX								

\* In some countries, bi-functional meters type 3 and 6 are only allowed to be assigned with the MID marking due to national law.

**Note:** The flow sensor is approved for the dynamic areas  $q_p:q_i$  250:1 and 100:1, but is, by default, delivered as  $q_p:q_i$  100:1.



## Product variants MULTICAL® 403

### MULTICAL® 403 type number

	Static data Written on the front of the meter				Dynamic data Shown in the display			
	403-X XX X XX -				XX X XX			
Type 403-	□	□□	□	□□	-	□□	□	□□
<b>Temperature sensor set</b>								
Supplied without temperature sensors							00	
<b>2-wire Pt500 temperature sensors</b>								
Direct short temperature sensors, 2 pcs.		DS 27.5 mm		1.5 m - 3 m			5x	
Direct short temperature sensors, 2 pcs.		DS 38 mm		1.5 m - 3 m			2x	
Direct short temperature sensors with composite union, 2 pcs.		ø5.0 mm		1.5 m - 3 m			6x	
Direct short temperature sensors with composite union, 2 pcs.		ø5.2 mm		1.5 m - 3 m			7x	
Pocket temperature sensors, 2 pcs.		PL ø5.8 mm		1.5 m - 5 m			8x	
Pocket temperature sensors, 2 pcs.		PL ø6.0 mm		1.5 m - 5 m			9x	
<b>Supply</b>								
No supply							0	
Battery, 1 x D-cell							2	
230 VAC High Power supply module							3	
24 VAC/VDC High Power supply module							4	
Battery, 1 x C-cell IoT							6	
230 VAC supply							7	
24 VAC supply							8	
Battery, 2 x A-cells							9	
<b>Modules</b>								
No module								00
Data Pulse, inputs (In-A, In-B)								10
Data Pulse, outputs (Out-C, Out-D)								11
Wired M-Bus, inputs (In-A, In-B)								20
Wired M-Bus, outputs (Out-C, Out-D)								21
Wired M-Bus, Thermal Disconnect *								22
linkIQ/wM-Bus, inputs (In-A, In-B), EU								32
linkIQ/wM-Bus, outputs (Out-C, Out-D), EU								33
wM-Bus, inputs (In-A, In-B), 912,5/915/918,5 MHz								34
Analog outputs 2 x 0/4...20 mA *								40
PQT Controller *								43
Low Power Radio, inputs (In-A, In-B), 434 MHz								50
Low Power Radio GDPR, inputs (In-A, In-B), 434 MHz								51
NB-IoT, inputs (In-A, In-B) **								56
BACnet MS/TP, inputs (In-A, In-B) *								66
Modbus RTU, inputs (In-A, In-B) *								67
BACnet IP, inputs (In-A, In-B) *								81
Modbus/KMP TCP/IP, inputs (In-A, In-B) *								82
READY TCP/IP, inputs (In-A, In-B)								83

\* The meter must be mains-supplied.

\*\* The meter must be supplied by either C-cell IoT battery or high power supply

Contact Kamstrup for further information about product variants.



## Meter configuration MULTICAL® 403

	A	B	CCC	DDD	EE	FF	GG	L	N	PP	RR	T	VVVV
<b>Flow sensor position</b>													
Inlet	3												
Outlet	4												
<b>Measuring unit</b>													
GJ		2											
kWh		3											
MWh		4											
<b>Flow sensor coding</b>													
7-digit CCC-codes			4xx										
8-digit CCC-codes			5xx										
<b>Display</b>													
Heat meter				210									
Heat/cooling meter				310									
Cooling meter				510									
<b>Tariffs</b>													
No active tariff					00								
Power tariff					11								
Flow tariff					12								
t1-t2 tariff					13								
Inlet tariff					14								
Outlet tariff					15								
Time-controlled tariff					19								
Heat/cooling volume tariff					20								
PQ tariff					21								
<b>Pulse inputs A and B</b>													
10 l/imp, pre-counter 1 (<10 m <sup>3</sup> /h)						24	24						
<b>Integration mode</b>													
Adaptive mode [4-64 s]								1					
Normal mode [32 s]								2					
Fast mode [4 s]								3					
<b>Cold water leak detection (input A)</b>													
OFF									0				
30 minutes without pulses									1				
1 hour without pulses									2				
2 hours without pulses									3				
<b>Pulse outputs Out-C/Out-D</b>													
Out-C: V1/4			5.0 ms							73			
Out-C: V1/1			3.9 ms							82			
Out-C: V1/4			22 ms							83			
E1 and V1 or E3 and V1			32 ms							95			
E1 and V1 or E3 and V1			100 ms [0.1 s]							96			
Controlled output based on data commands										99			
<b>Data logger profile</b>													
Standard data logger profile											30		
<b>Encryption level</b>													
Individual key												3	
<b>Customer label</b>													
Serial number													0000

Contact Kamstrup A/S for further information about meter configuration.



## Information codes in display

Display digit								Description
1	2	3	4	5	6	7	8	
Info	t1	t2	0	V1	0	0	0	
1								Supply voltage is missing
2								Low battery level
9 *								External alarm (e.g. via KMP)
	1							t1 above measuring range or disconnected
		1						t2 above measuring range or disconnected
	2							t1 below measuring range or short-circuited
		2						t2 below measuring range or short-circuited
	9	9						Invalid temperature difference (t1-t2)
				3				V1 Air
				4				V1 Wrong flow direction
				6				V1 > q <sub>s</sub> for more than one hour
						8 *		Pulse input A Leakage in the system
						9 *		Pulse input A External alarm
							8 *	Pulse input B Leakage in the system
							9 *	Pulse input B External alarm

### Example:

1	0	2	0	0	0	9	0
---	---	---	---	---	---	---	---

\* Only MULTICAL® 403

**Note:** Info codes are configurable. It is thus not certain that all parameters are available in a given MULTICAL® 303 or MULTICAL® 403.

An info logger stores the info code each time the info code is changed. It is possible to read the latest 50 changes of the info code as well as the date of the change.



## Accessories

Type number	Description	MULTICAL® 303	MULTICAL® 403
HC-993-09	Battery module with 2xA-cell		X
HC-993-02	Battery module with 1xD-cell		X
HC-993-06	Battery module with 1xC-cell IoT		X
HC-993-07	230 VAC supply module		X
HC-993-08	24 VAC supply module		X
HC-993-03	230 VAC High Power supply module		X
HC-993-04	24 VAC/VDC High Power supply module		X
2210-061	Gasket for flow sensor G¾B (R½) / coupling 6561-323	X	X
2210-062	Gasket for flow sensor G1B (R¾) / coupling 6561-324	X	X
2105-002	Sealing cap for flow sensor G¾B (R½), blue	X	X
3026-1148	Sealing cap for flow sensor G¾B (R½), self-locking, blue	X	X
3026-517	Sealing cap for direct short temperature sensor DS27,5, blue	X	X
3026-518	Sealing cap for direct short temperature sensor DS27,5, red	X	X
3026-1034	Sealing cap for ø5.0 mm / ø5.2 mm temperature sensor with composite union, black	X	X
3026-655.A	Wall bracket including rawplugs and screws	X	X
3026-902	Bracket for mounting MULTICAL® 403 on wall bracket for MULTICAL® 402		X
3026-909	Holder for optical read-out head	X	X
3026-961	Disassemble tool base		X
3026-962	Disassemble tool bracket		X
3130-262	Blind plug including O-ring for the temperature sensor connecting in the flow sensor	X	X
3130-269	Cable clamp with screws		X
5000-286	Supply cable, 1.5 m (2 x 0.75 m <sup>2</sup> )		X
5000-337	Module cable 2 m (2 x 0.25 m <sup>2</sup> )		X
6556-491	R½ - M10 nipple for direct short temperature sensor	X	X
6556-492	R¾ - M10 nipple for direct short temperature sensor	X	X
6556-570	G¾B ball valve with M10x1 sensor socket, 48 mm	X	
6556-571	G¾B ball valve with M10x1 sensor socket, 54 mm	X	
6699-035	USB module configuration cable		X
6699-042	Metal plate for optical readout head, 20 pcs.	X	X
6699-047	Supply label MULTICAL® 403/603, 10 pcs. [2006-681]		X
6699-099	Infrared optical readout head with USB plug	X	X
6699-403	230/24 VAC safety transformer 5 VA		X
6699-404	230/24 VAC safety transformer 10 VA		X
6699-405	230/12/24 VAC safety transformer 63 VA		X
6699-447.E	Internal antenna for Kamstrup radio, 434 MHz		X
6699-448	Mini Triangle antenna for Wireless M-Bus and 2G/4G Network Module		X
6699-482.E	Internal antenna for Wireless M-Bus 868 MHz		X



## Accessories

### Calibration units

Type number	Description	MULTICAL® 303	MULTICAL® 403
6699-303	Verification unit for MULTICAL® 303 Pt500, heat/cooling (used with METERTOOL HCW)	x	
6699-367	Verification unit for MULTICAL® 403, Pt100, heat/cooling (used with METERTOOL HCW)		x
6699-366	Verification unit for MULTICAL® 403, Pt500, heat/cooling (used with METERTOOL HCW)		x

For further information on MULTICAL® 303, MULTICAL® 403 and their accessories, please refer to the technical description, which you can find on [Kamstrup Product Centre](#).

### Kamstrup A/S

Industrivej 28, Stilling  
 DK-8660 Skanderborg  
 T: +45 89 93 10 00  
 info@kamstrup.com  
 kamstrup.com