

Display user guide for Kamstrup OMNIPOWER CT electricity meter

Intermediate 2 – Display configuration 711


OBIS code
Identification number.

Phase indication
L1 flashes when there is voltage on the phase.
The arrow indicates the present current direction.

Optical infrared eye
For reading and programming data.

SO diode
Flashes 10,000 times per kWh.
The display changes via the button – the change takes place upon button release.
Approx. 2 minutes after the last button press, the display changes automatically to the view 1.8.0 – accumulated electricity consumption in kWh.


Normal display



Accumulated active positive energy


Total electricity consumption from the electricity grid.
Measured in kilowatt hours

3

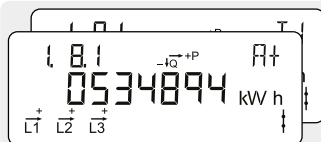


Accumulated active positive energy Tariff 1

Total electricity consumption from the electricity grid for Tariff 1.
Measured in kilowatt hours




Accumulated active positive energy Tariff 2

Total electricity consumption from the electricity grid for Tariff 2.
Measured in kilowatt hours

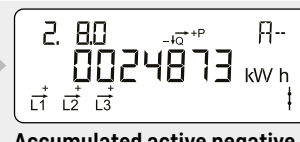


Accumulated active negative energy

Total electricity production for the electricity grid.
Measured in kilowatt hours

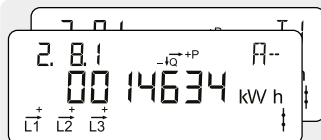


Accumulated active negative energy Tariff 1

Total electricity consumption for the electricity grid for Tariff 1.
Measured in kilowatt hours



Accumulated active negative energy Tariff 2


Total electricity consumption for the electricity grid for Tariff 2.
Measured in kilowatt hours

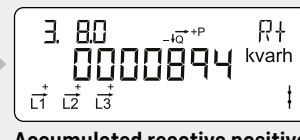


Accumulated reactive positive energy

Total reactive electricity consumption from the electricity grid.
Measured in kilovolt ampere reactive hours


2

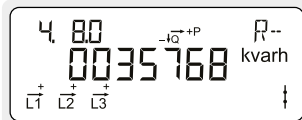


Accumulated reactive negative energy R0
Total reactive electricity production for the electricity grid.
Measured in kilovolt ampere reactive hours [kvarh].




Accumulated reactive energy R1
Total inductive reactive electricity consumption from the electricity grid.
Measured in kilovolt ampere reactive hours [kvarh].




Accumulated reactive energy R2
Total capacitive reactive electricity production for the electricity grid.
Measured in kilovolt ampere reactive hours [kvarh].

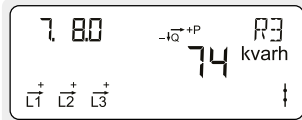


Accumulated reactive energy R3
Total inductive reactive electricity production for the electricity grid.
Measured in kilovolt ampere reactive hours [kvarh].




Accumulated reactive energy R4
Total capacitive reactive electricity consumption from the electricity grid.
Measured in kilovolt ampere reactive hours [kvarh].




Actual active positive power P+
Instantaneous electricity consumption from the electricity grid.
Measured in kilowatt [kW].

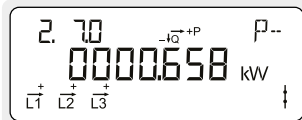


Actual active negative power P-
Instantaneous electricity production for the electricity grid.
Measured in kilowatt [kW].




Actual voltage phase L1
Measured in volts [V].




Actual voltage phase L2
Measured in volts [V].




Actual voltage phase L3
Measured in volts [V].




Actual current phase L1
Measured in ampere [A].




Actual current phase L2
Measured in ampere [A].




Actual current phase L3
Measured in ampere [A].




Transformer ratio
Transformer ratio for current transformers.




Accumulated secondary active positive energy A+S
Total secondary electricity consumption from the electricity grid.
Measured in kilowatt hours [kWh].



Accumulated secondary active negative energy A-S
Total secondary electricity production for the electricity grid.
Measured in kilowatt hours [kWh].



Accumulated secondary reactive positive energy R+S
Total secondary reactive electricity consumption from the electricity grid.
Measured in kilovolt ampere reactive hours [kvarh].



Accumulated secondary reactive negative energy R-S
Total secondary reactive electricity production for the electricity grid.
Measured in kilovolt ampere reactive hours [kvarh].

